


Retained Material:-
Scrap Metal
AoR = 30 degrees
Maximum Density
20 kN/m³ (2000 kgs/m³)

It is up to the client to advise if these parameters are not correct.


Design Parameters
Load Case 1 - 20kN/m³ (2000kgs/m³)
Level Fill (1:50)

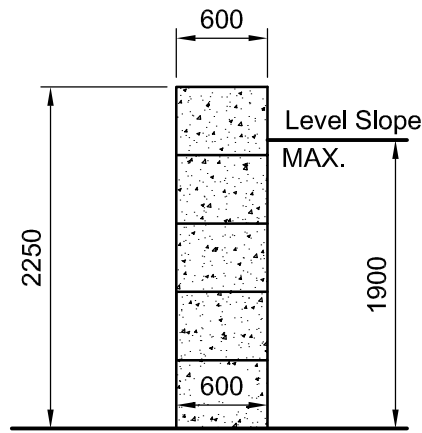

Retained Material:-
Scrap Metal
AoR = 30 degrees
Maximum Density
15 kN/m³ (1500 kgs/m³)

It is up to the client to advise if these parameters are not correct.


Design Parameters
Load Case 2 - 15kN/m³ (1500kgs/m³)
Level Fill (1:50)

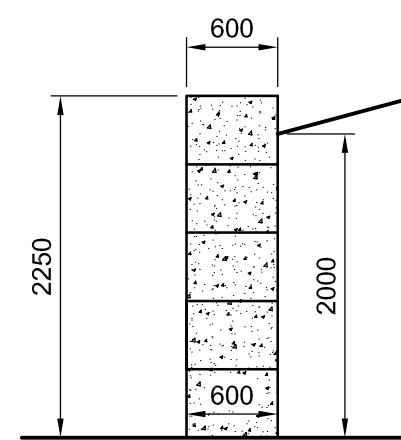

Retained Material:-
Scrap Metal
AoR = 30 degrees
Maximum Density
10 kN/m³ (1000 kgs/m³)

It is up to the client to advise if these parameters are not correct.


Design Parameters
Load Case 3 - 10kN/m³ (1000kgs/m³)
15 Degree Fill (1:50)

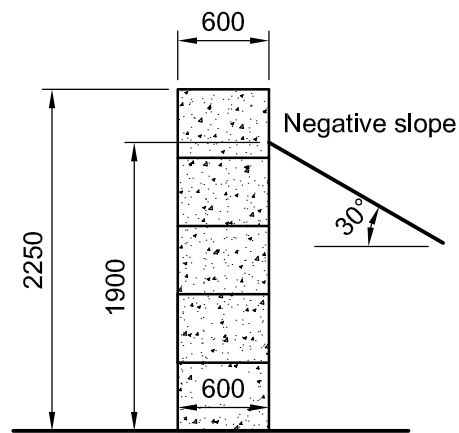

Retained Material:-
Scrap Metal
AoR = 30 degrees
Maximum Density
20 kN/m³ (2000 kgs/m³)

It is up to the client to advise if these parameters are not correct.

Design Parameters
Load Case 4 - 20kN/m³ (2000kgs/m³)
Negative Fill (1:50)

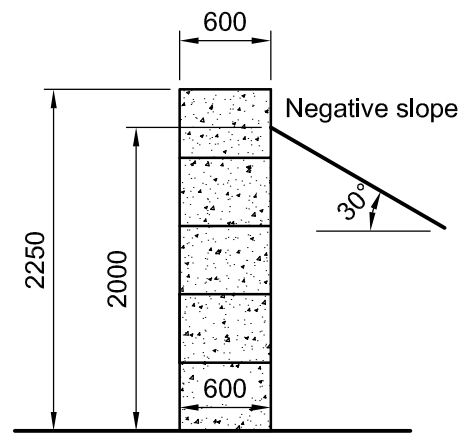


Retained Material:-
Scrap Metal
AoR = 30 degrees
Maximum Density
15 kN/m³ (1500 kgs/m³)

It is up to the client to advise if these parameters are not correct.

Design Parameters
Load Case 5 - 15kN/m³ (1500kgs/m³)
Negative Fill (1:50)

Important Note - The retained material should be allowed to naturally fall against the wall as it is stacked. Do not allow the retained material to stand up on its own as this could lead to a catastrophic failure of the material and the wall. The wall has not been designed to withstand the impact of the retained material suddenly falling against the wall due to incorrect loading.

NOTE:-
The bearing pressure beneath the wall is shown below. **It is up to the client to ensure the ground and slab is adequate**, alternatively a foundation may be designed to suit allowable ground bearing pressures if required.

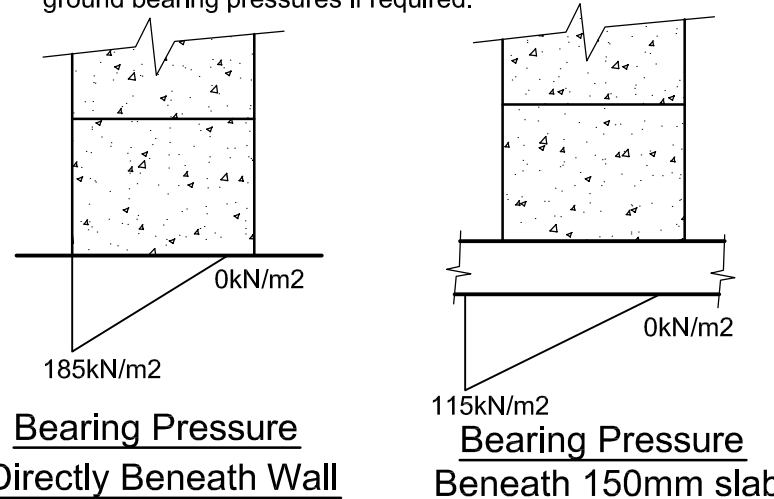

Bearing Pressures
Generally (1:25)

- NOTES:-
1. The contractor should take all necessary measurements on site.
 2. All dimensions shown on this drawing are approximate and for structural calculation purposes only.
 3. Dimensions on this drawing should not be used for fabrication purposes.
 4. Do not scale this drawing.
 5. This drawing should be read in conjunction with the calculations.

IMPORTANT NOTE
The wall has been designed to retain a specific material with a specific density and angle of repose. It is up to the client to ensure that the material retained on site does not exceed these designed parameters, failure to do so may result in the collapse of the wall.

IMPORTANT NOTE
The existing slab and ground have not been investigated by CLP structures, the pressures exerted on the ground and slab are shown on this drawing, however **it is up to the client to satisfy himself that the existing ground and slab are adequate to support these loads.**

Rev	Description	By	Date	Chk'd
Purpose of Issue	Rev	Date	Auth	



CLP Structures
STRUCTURAL ENGINEERING CONSULTANTS
EMAIL: mail@CLP-Structures.co.uk
TEL: 0117 3706357

Client
Elite Precast Concrete Ltd.

Project
**Elite Duoblock Wall
General Loading Conditions**

Title
**Wall Design Parameters
and Limitations**

Original Scale As noted	Drawn CEL Date Mar 17	Rev - Checked
Drawing Number		572-03