



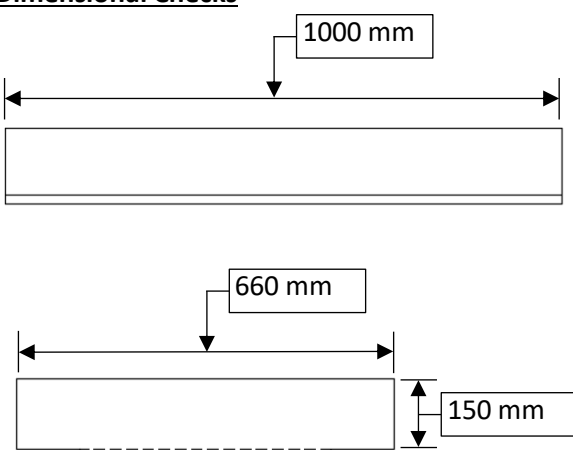

Factory Production Control Manual	Version No.: 001	PR/PR/REV001/RJM/07.09.2020
-----------------------------------	------------------	-----------------------------

Vertical Load Test Report	Form QS9 Rev002/RJM/EPC/June16
Product 1197 Duct lid	Date Made 19/08/2020
Dimensional Checks  <p>Tolerances : Thickness not less than normal $\pm 5.0\text{mm}$</p>	Date Tested 07/09/2020
	Test Age 19
	Bedding Condition ok
	Age of the Bed 3 Days
	Proof load applied (Fp) 400 KN
	Residual crack width (max. 0.15mm) N/A
	Collapse Load (Fu) (cover and ITT only) (min 300kN) 400 KN no failure
Visual appearance (cracks or surface voids): 0 Acceptable (DELETE AS APPLICABLE)	

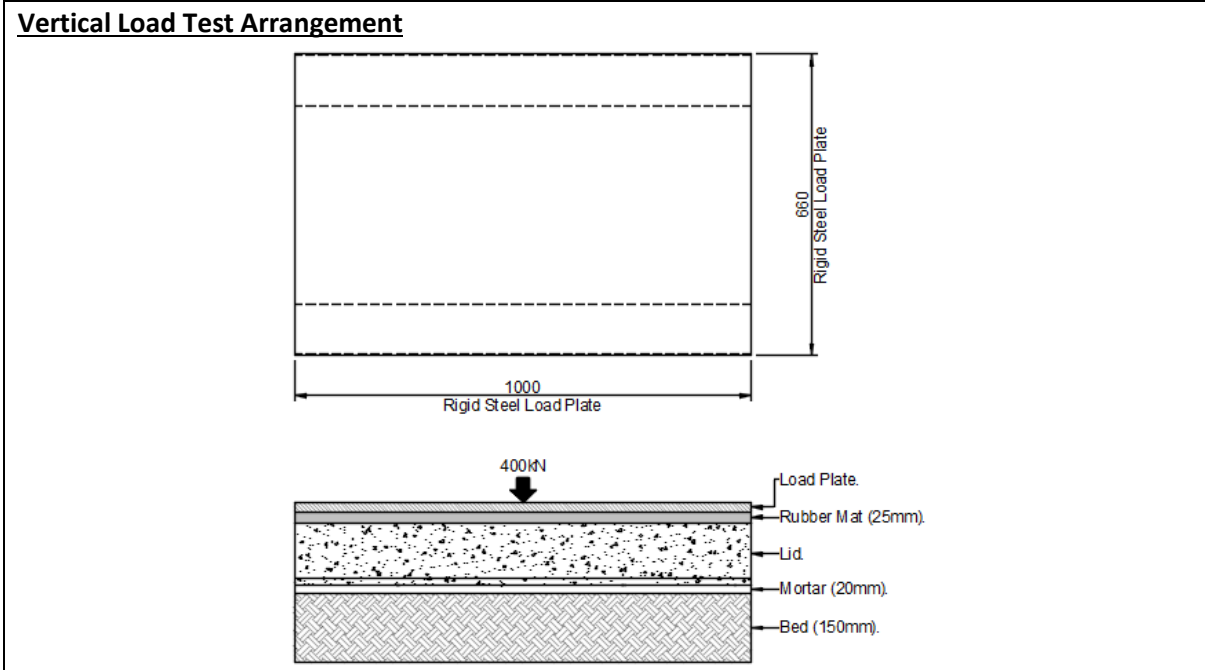

Tested By : S.Savigar	Result (PASS/FAIL) PASS
------------------------------	--------------------------------