

# elite precast

TF7 4QW  
01952 728852

Report Title	protection slabs
Report Date	21 Jan 2022 15:10
Compiled By	steven James Savigar


Signature



Customer Company Name	elite precast
Customer Address	
Site Name	
Site Address	
Customer Contact Name	
Customer Contact Tel	
Customer Contact Email	
Test Conclusion	


Test Title

01:52 PM 21 Jan 2022

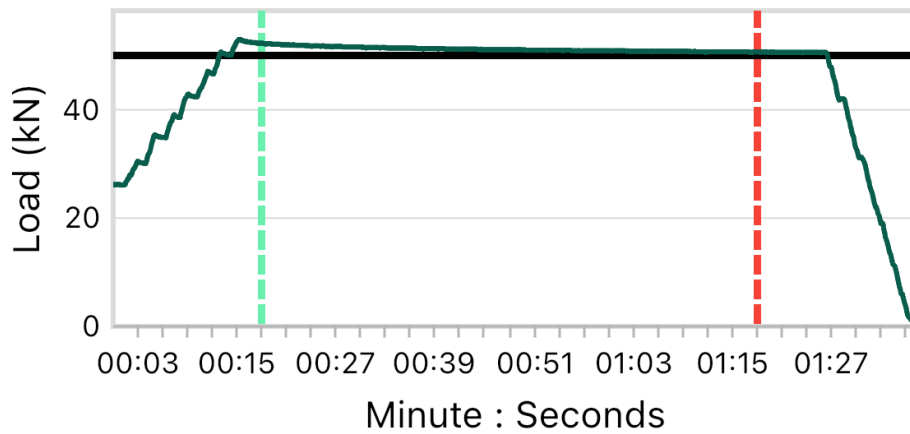

Date & Time	21 Jan 2022 13:52	Maximum Load Achieved	53.0 kN
Target Load	50.0 kN	Device SN	228
Timed Section Started	00:18	Timed Section Finished	01:18
Timed Section Length	01:00	Next Calibration Date	02 Dec 2022
Test Result	Test Result Pass		


Notes

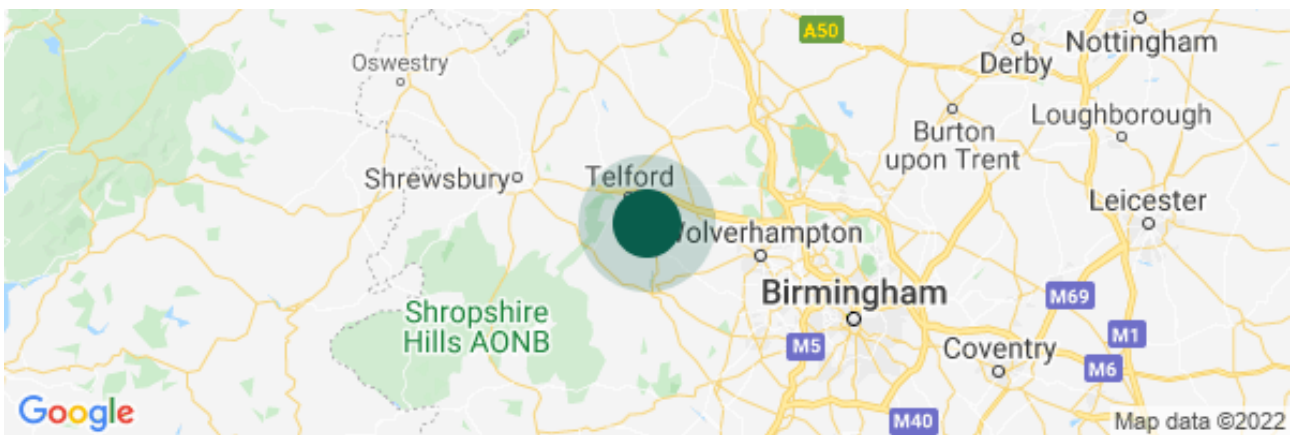



Test Title

01:23 PM 21 Jan 2022

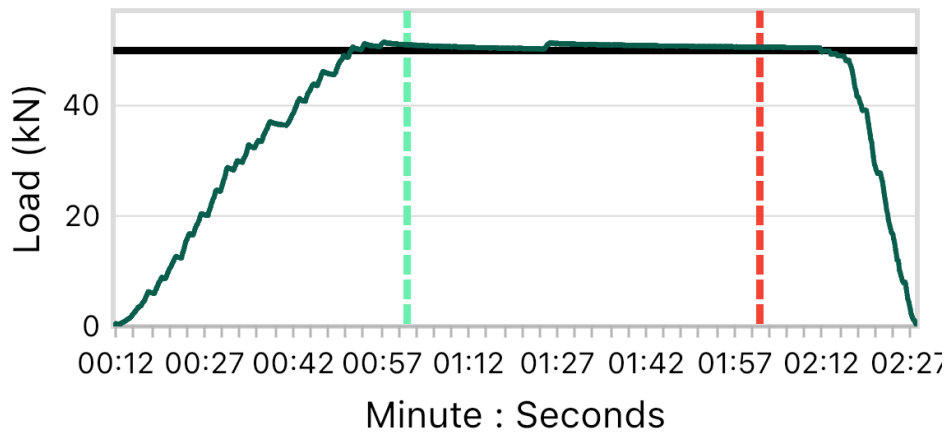

Date & Time	21 Jan 2022 13:23	Maximum Load Achieved	51.5 kN
Target Load	50.0 kN	Device SN	228
Timed Section Started	01:01	Timed Section Finished	02:01
Timed Section Length	01:00	Next Calibration Date	02 Dec 2022
Test Result	Test Result Pass		

Notes

