

Report Title	LG8 Fresh
Report Date	16 Feb 2022 10:58
Compiled By	steven James Savigar


Signature



Customer Company Name	Elite Precast Concrete
Customer Address	
Site Name	
Site Address	
Customer Contact Name	
Customer Contact Tel	
Customer Contact Email	
Test Conclusion	

Test Title

10:51 AM 16 Feb 2022

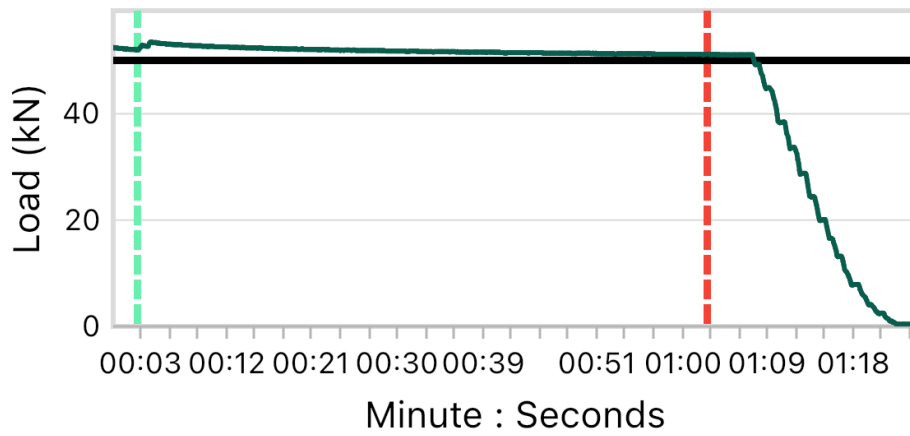

Date & Time	16 Feb 2022 10:51	Maximum Load Achieved	53.5 kN
Target Load	50.0 kN	Device SN	228
Timed Section Started	00:02	Timed Section Finished	01:02
Timed Section Length	01:00	Next Calibration Date	02 Dec 2022
Test Result	Test Result Pass		

Notes

fresh out of mould this morning pin passed and concrete

